
NP-Series - Valve Regulated Lead Acid Battery

NP1.2-6

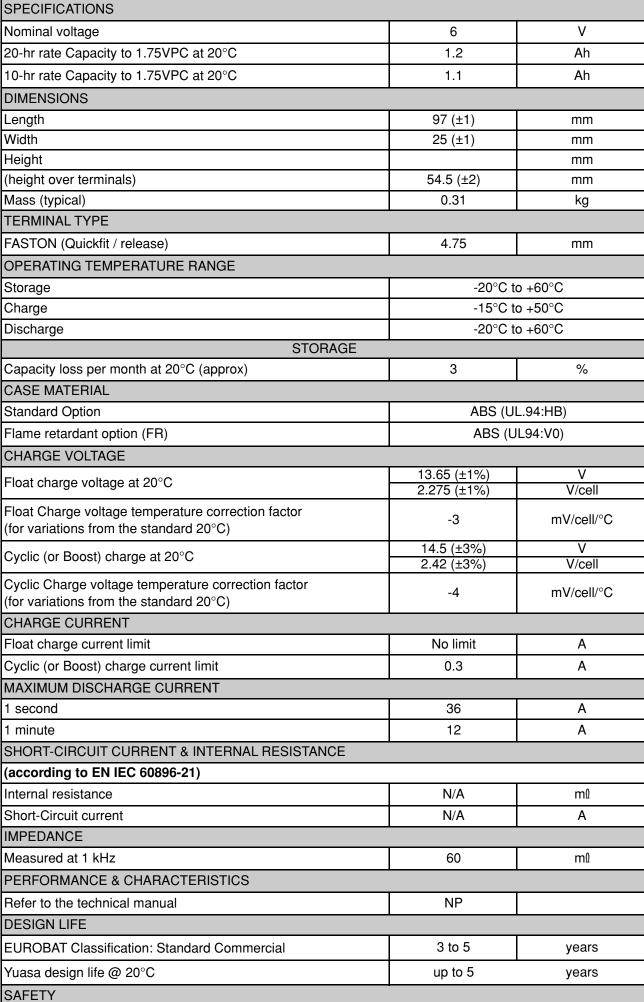

Installation

Can be installed and operated in any orientation except permanently inverted

Handles

Batteries must not be suspended by their handles (where fitted)

Vent valves

Each cell is fitted with a low pressure release valve to allow gasses to escape and then reseal.

Gas Release


VRLA Batteries release hydrogen gas which can form explosive mixtures in air. Do not place inside a sealed container

Recycling

YUASA's VRLA batteries must be recycled at the end of life in accordance with local and national laws and regulations

Data Sheet



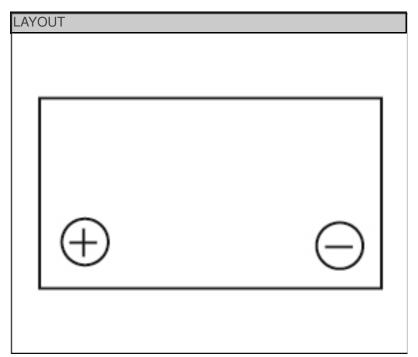

3RD PARTY CERTIFICATIONS

ISO 9001 - Quality Management Systems ISO 14001 - Environmental Management Systems EN 18001 - OHSAS Management Systems UNDERWRITERS LABORATORIES Inc.



STANDARDS

IEC61056







ALL DATA IS SUBJECT TO CHANGE WITHOUT NOTICE Issue No.: V.1 / Issue Date: July 2010



YUASA BATTERY SALES UK LTD. Unit 22 Rassau Industrial Estate Ebbw Vale, Gwent **NP23 5SD** UK