
NP-Series - Valve Regulated Lead Acid Battery NP10-6

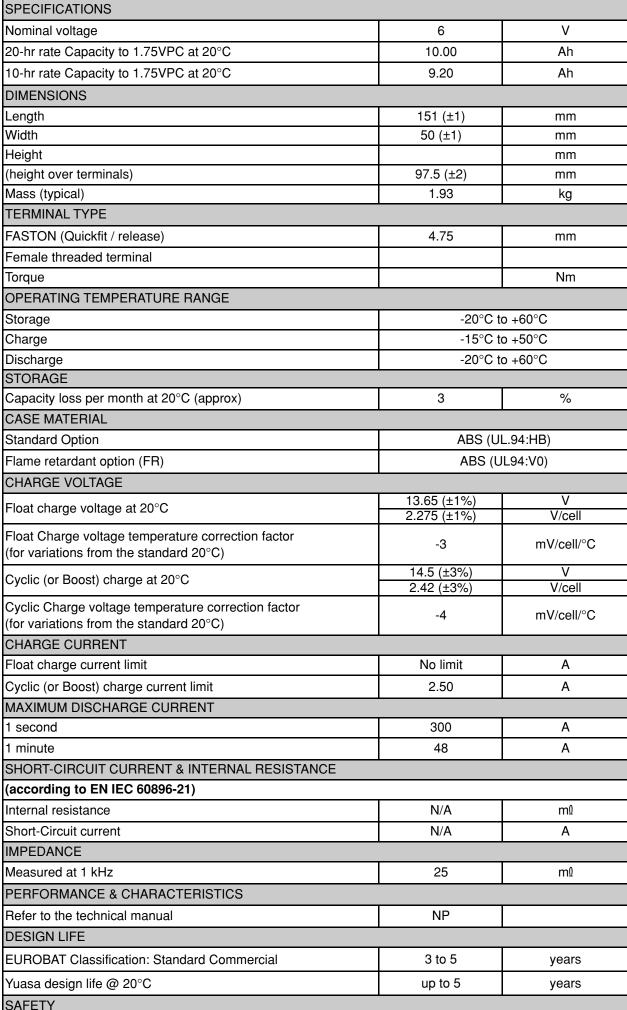

SAFETY

Installation

Can be installed and operated in any orientation except permanently inverted

Handles

Batteries must not be suspended by their handles (where fitted)

Each cell is fitted with a low pressure release valve to allow gasses to escape and then reseal.

Gas Release

VRLA Batteries release hydrogen gas which can form explosive mixtures in air. Do not place inside a sealed container


Recycling

YUASA's VRLA batteries must be recycled at the end of life in accordance with local and national laws and regulations

Data Sheet



LAYOUT

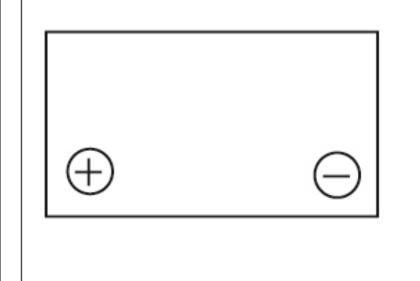

3RD PARTY CERTIFICATIONS

ISO 9001 - Quality Management Systems ISO 14001 - Environmental Management Systems EN 18001 - OHSAS Management Systems UNDERWRITERS LABORATORIES Inc. VdS (Germany) - VdS No: G189170



IEC61056







ALL DATA IS SUBJECT TO CHANGE WITHOUT NOTICE

Issue No.: V.1 / Issue Date: July 2010



YUASA BATTERY SALES UK LTD. Unit 22 Rassau Industrial Estate Ebbw Vale, Gwent **NP23 5SD** UK