



192274 NZMH3-PX250-TAZ-AVE

Overview

Specifications

Resources







## **DELIVERY PROGRAM**

Delivery program

Product range Orcuit-breaker

Technical data

Design verification as per IEC/EN 61439

Protective function

Systems, cable, selectivity and generator

protection

Earth-fault protection Zone selectivity

ARVS maintenance mode

Technical data ETIM 7.0

Standard/Approval

IEC

Characteristics

Installation type Withdrawable

Dimensions

Release system Bectronic release

Construction size

NZM3

Description
LSIG overload protection and delayed and non-delayed short-circuit protective device, earth-fault protection
Class 1 energy measurement, r.ms. value measurement, and "thermal memory"
USB interface for configuration and test function with Power Xpert Protection Manager software Zone selectivity ZSI
Maintenance Mode ARMS
Interface module in equipment supplied.
Optionally communication-capable with internal

Number of poles 3 pole

Modbus RTU module or CAM

Standard equipment Screw connection

### **Switching capacity**

 $400/415 \text{ V } 50 \text{ Hz } [l_{cu}]$  150 kA

## Rated current = rated uninterrupted current $[I_n = I_u]$

Rated current = rated uninterrupted current  $[I_n = I_u]$  250 A

### **Setting range**

Overload trip
[I<sub>r</sub>]
100 - 250 A

Short-circuit releases  $[l_{rm}]$ Non-delayed  $[l_i = l_n \times ...]$ 2-18

Short-circuit releases  $[l_{km}]$  Delayed  $[l_{sd} = l_r \times ...]$  2-10

Setting range of earth fault release min. [lg = lnx...] 50

Setting range of earth fault release max. [ $\lg = \ln x$ ...] 250

## **TECHNICAL DATA**

#### **General**

Standards IEC/EN 60947

Protection against direct contact Finger and back of hand proof to VDE0106 Part 100

Climatic proofing
Damp heat, constant, to IEC 60068-2-78
Damp heat, cyclic, to IEC 60068-2-30

Ambient temperature Ambient temperature, storage - 40 - + 70 °C

Ambient temperature Operation -25 - +70 °C

Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 20 (half-sinusoidal shock 20 ms) g

Safe isolation to EN 61140 Between auxiliary contacts and main contacts 500 V AC

Safe isolation to BN 61140 between the auxiliary contacts 300 V AC

Mounting position

Vertical and 90° in all directions

With XFI earth-fault release:



- NZM1, N1, NZM2, N2: vertical and 90° in all directions

with plug-in unit

- NZM1, N1, NZM2, N2: vertical, 90° right/left

with withdrawable unit:

- NZNB, NB: vertical, 90° right/left

- NZM4, N4: vertical with remote operator:

- NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions

Direction of incoming supply as required

Degree of protection
Device
In the operating controls area: IP20 (basic degree of protection)

Degree of protection
Enclosures
With insulating surround: IP40
With door coupling rotary handle: IP66

Degree of protection Terminations Tunnel terminal: IP10 Phase isolator and strip terminal: IP00

Other technical data (sheet catalogue)
Weight
Temperature dependency, Derating
Effective power loss

#### **Circuit-breakers**

Rated current = rated uninterrupted current [ $I_n = I_u$ ] 250 A

Rated surge voltage invariability [ $U_{mp}$ ] Main contacts 8000 V

Rated surge voltage invariability  $[U_{mp}]$  Auxiliary contacts

6000 V

Rated operational voltage  $[U_e]$  690 V AC

Overvoltage category/pollution degree III/3

Rated insulation voltage [U<sub>i</sub>] 690 V

Use in unearthed supply systems  $\square$  690 V

### **Switching capacity**

Rated short-circuit making capacity [ $l_{cm}$ ] 240 V [ $l_{cm}$ ] 330 kA

Rated short-circuit making capacity [ $l_{cm}$ ] 400/415 V [ $l_{cm}$ ] 330 kA

Rated short-circuit making capacity [ $l_{cm}$ ] 440 V 50/60 Hz [ $l_{cm}$ ] 286 kA

Rated short-circuit making capacity [ $l_{cm}$ ] 525 V 50/60 Hz [ $l_{cm}$ ] 143 kA

Rated short-circuit making capacity [ $l_{cm}$ ] 690 V 50/60 H [lc] 74 kA

Rated short-circuit breaking capacity  $l_{cn}$  [ $l_{cn}$ ] lcu to IEC/EN 60947 test cycle O-t-CO [lcu] 240 V 50/60 Hz [ $l_{cu}$ ] 150 kA

Rated short-circuit breaking capacity  $l_{cn}$  [ $l_{cn}$ ] lcu to IEC/EN 60947 test cycle O-t-CO [lcu] 400/415 V 50/60 Hz [ $l_{cu}$ ] 150 kA

Rated short-circuit breaking capacity  $l_{cn}$  [ $l_{cn}$ ] lcu to IEC/EN 60947 test cycle O-t-CO [lcu] 440 V 50/60 Hz [ $l_{cu}$ ] 130 kA

Rated short-circuit breaking capacity  $l_{cn}$  [ $l_{cn}$ ] lcu to IEC/EN 60947 test cycle O-t-CO [lcu] 525 V 50/60 Hz [ $l_{cu}$ ] 65 kA

Rated short-circuit breaking capacity  $l_{cn}$  [ $l_{cn}$ ] lcu to IEC/EN 60947 test cycle O-t-CO [lcu] 690 V 50/60 Hz [ $l_{cu}$ ] 35 kA

Rated short-circuit breaking capacity  $l_{cn}$  [ $l_{cn}$ ] lcs to IEC/EN 60947 test cycle O-t-CO-t-CO [lcs] 240 V 50/60 Hz [ $l_{cs}$ ] 150 kA

Rated short-circuit breaking capacity  $l_{cn}$  [ $l_{cn}$ ] lcs to IEC/EN 60947 test cycle O-t-OO-t-OO [lcs] 400/415 V 50/60 Hz [ $l_{cs}$ ] 150 kA

Rated short-circuit breaking capacity  $l_{cn}$  [ $l_{cn}$ ] lcs to IEC/EN 60947 test cycle O-t-OO-t-OO [lcs] 440 V 50/60 Hz [ $l_{cs}$ ] 130 kA

Rated short-circuit breaking capacity  $l_{cn}$  [ $l_{cn}$ ] lcs to IEC/EN 60947 test cycle O-t-CO-t-CO [lcs] 525 V 50/60 Hz [ $l_{cs}$ ] 33 kA

Rated short-circuit breaking capacity  $l_{cn}$  [ $l_{cn}$ ] lcs to IEC/EN 60947 test cycle O-t-CO-t-CO [lcs] 690 V 50/60 Hz [ $l_{cs}$ ] 9 kA

Rated short-circuit breaking capacity  $l_{cn}$  [ $l_{cn}$ ] Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.

Rated short-time withstand current  $t = 0.3 \, s \, [l_{sw}]$  3.3 kA

Rated short-time withstand current

 $t = 1 s [l_{cw}]$ 3.3 kA

Utilization category to IEC/EN 60947-2  $_\Delta$ 

Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release) [Operations] 15000

Lifespan, electrical AC-1 400 V 50/60 Hz [Operations] 5000

Lifespan, electrical AC-1 415 V 50/60 Hz [Operations] 5000

Lifespan, electrical AC-1 690 V 50/60 Hz [Operations] 3000

Lifespan, electrical Max. operating frequency 60 Ops/h

Total break time at short-circuit < 10 ms

## **Terminal capacity**

Standard equipment Screw connection

Accessories required NZMB-XAVS

Optional accessories Box terminal Tunnel terminal connection on rear

Round copper conductor Box terminal Solid 2 x 16 mm<sup>2</sup>

Round copper conductor Box terminal Stranded 1 x (35 - 240) 2 x (25-120) mm<sup>2</sup>

Round copper conductor Tunnel terminal Solid 1 x 16 mm<sup>2</sup>

Round copper conductor Tunnel terminal Stranded 1-hole 1 x (16 - 185) mm<sup>2</sup>

Round copper conductor
Bolt terminal and rear-side connection
Direct on the switch
Solid
1 x 16
2 x 16 mm²

Round copper conductor
Bolt terminal and rear-side connection
Direct on the switch
Stranded
1 x (25 - 240)
2 x (25 - 240) mm²

Round copper conductor
Bolt terminal and rear-side connection
Connection width extension
Connection width extension
2 x 300 mm<sup>2</sup>

Al circular conductor Tunnel terminal Solid 1 x 16 mm<sup>2</sup>

Al circular conductor Tunnel terminal Stranded Stranded 1 x (25 - 185) <sup>2)</sup> mm<sup>2</sup>

Al circular conductor

Tunnel terminal Stranded Double hole 1 x (50 - 240) 2 x (50 - 240) mm²

Al circular conductor Tunnel terminal Stranded <sup>2)</sup> Up to 240 mm² can be connected depending on the cable manufacturer.

Ou strip (number of segments x width x segment thickness)

Box terminal [min.]

6 x 16 x 0.8 mm

Ou strip (number of segments x width x segment thickness)

Box terminal [max.]

10 x 24 x 1.0

+ 5 x 24 x 1.0

(2 x) 8 x 24 x 1.0 mm

Ou strip (number of segments x width x segment thickness)

Bolt terminal and rear-side connection

Flat copper strip, with holes [min.]

6 x 16 x 0.8 mm

Ou strip (number of segments x width x segment thickness)

Bolt terminal and rear-side connection

Flat copper strip, with holes [max.]  $10 \times 32 \times 1.0 + 5 \times 32 \times 1.0 \text{ mm}$ 

Qu strip (number of segments x width x segment thickness)

Bolt terminal and rear-side connection

Connection width extension

(2 x) 10 x 50 x 1.0 mm

Copper busbar (width x thickness) [mm] Bolt terminal and rear-side connection Screw connection M10

Copper busbar (width x thickness) [mm] Bolt terminal and rear-side connection Direct on the switch [min.] 20 x 5 mm Copper busbar (width x thickness) [mm]
Bolt terminal and rear-side connection
Direct on the switch [max.]
30 x 10
+ 30 x 5 mm

Copper busbar (width x thickness) [mm]
Bolt terminal and rear-side connection
Connection width extension
Connection width extension [max.]
2 x (10 x 50) mm

Control cables 1 x (0.75 - 2.5) 2 x (0.75 - 1.5) mm<sup>2</sup>

## **DESIGN VERIFICATION AS PER IEC/EN 61439**

### Technical data for design verification

Rated operational current for specified heat dissipation [In] 250 A

Equipment heat dissipation, current-dependent  $[P_{\text{id}}]$ 18.75 W

Operating ambient temperature min. -25  $^{\circ}\text{C}$ 

Operating ambient temperature max. +70 °C

### IEC/EN 61439 design verification

10.2 Strength of materials and parts10.2.2 Corrosion resistanceWeets the product standard's requirements.

10.2 Strength of materials and parts 10.2.3.1 Verification of thermal stability of enclosures Weets the product standard's requirements. 10.2 Strength of materials and parts 10.2.3.2 Verification of resistance of insulating materials to normal heat Meets the product standard's requirements.

10.2 Strength of materials and parts
10.2.3.3 Verification of resistance of insulating
materials to abnormal heat and fire due to internal
electric effects
Meets the product standard's requirements.

10.2 Strength of materials and parts 10.2.4 Resistance to ultra-violet (UV) radiation Meets the product standard's requirements.

10.2 Strength of materials and parts10.2.5 LiftingDoes not apply, since the entire switchgear needs to be evaluated.

10.2 Strength of materials and parts10.2.6 Mechanical impactDoes not apply, since the entire switchgear needs to be evaluated.

10.2 Strength of materials and parts10.2.7 InscriptionsMeets the product standard's requirements.

10.3 Degree of protection of ASSEVBLIES Does not apply, since the entire switchgear needs to be evaluated.

10.4 Clearances and creepage distances Meets the product standard's requirements.

10.5 Protection against electric shock
Does not apply, since the entire switchgear needs
to be evaluated.

10.6 Incorporation of switching devices and components

Does not apply, since the entire switchgear needs to be evaluated.

10.7 Internal electrical circuits and connections Is the panel builder's responsibility.

10.8 Connections for external conductors Is the panel builder's responsibility.

10.9 Insulation properties 10.9.2 Power-frequency electric strength Is the panel builder's responsibility.

10.9 Insulation properties 10.9.3 Impulse withstand voltage Is the panel builder's responsibility.

10.9 Insulation properties 10.9.4 Testing of enclosures made of insulating material Is the panel builder's responsibility.

10.10 Temperature rise
The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.

10.11 Short-circuit rating Is the panel builder's responsibility. The specifications for the switchgear must be observed.

10.12 Electromagnetic compatibility Is the panel builder's responsibility. The specifications for the switchgear must be observed.


10.13 Mechanical function

The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

## **TECHNICAL DATA ETIM 7.0**

 $Low-voltage\ industrial\ components\ (EG000017)\ /\ Power\ circuit-breaker\ for\ trafo/generator/installation\ protection\ (EC000228)$ 

Bectric engineering, automation, process control engineering / Low-voltage switch technology / Orcuit breaker (LV < 1 kV) / Orcuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

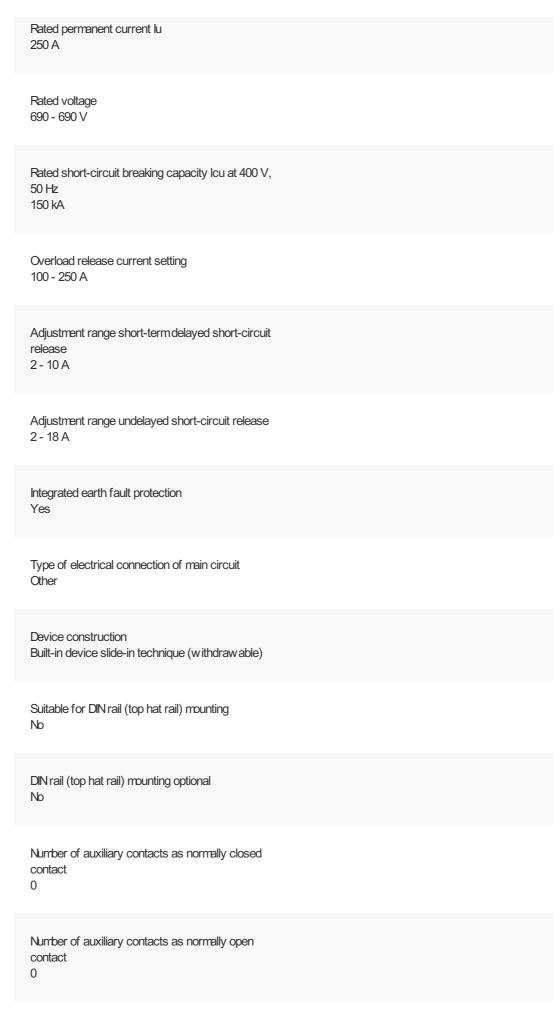

Number of auxiliary contacts as change-over contact

With switched-off indicator No
With under voltage release No
Number of poles
Position of connection for main current circuit Connection at separate chassis part
Type of control element Rocker lever
Complete device with protection unit Yes
Motor drive integrated No
Motor drive optional Yes
Degree of protection (IP) IP20

## **CHARACTERISTICS**

Characteristic curve	
Let-through current	
Characteristic curve	

Let-through energy

# **DIMENSIONS**

☐ Blow out area, minimum clearance to adjacent parts ☐ Mnimum clearance to adjacent parts	





