SIEMENS

Data sheet

3RR2141-1AA30



Monitoring relay, attachable to contactor 3RT2, size S00 Basic, analog adjustment Apparent current monitoring 1.6-16 A, 20-400 Hz, 2-phase Supply 24 V AC/DC 1 changeover contact Monitoring for current overshoot and undershoot Phase failure, wire break with or without fault buffer ON delay 0-60 s Spurious peak suppr. 0-30 s Switching hysteresis 6% Screw terminal

| General technical data: | | |
|--|----|---|
| product brandname | | SIRIUS |
| Product designation | | Monitoring relays |
| Design of the product | | analogically adjustable, 2-phase current monitoring |
| Size of contactor can be combined company-specific | | S00 |
| Protection class IP | - | |
| • on the front | | IP20 |
| • of the terminal | | IP20 |
| Insulation voltage for overvoltage category III | V | 690 |
| according to IEC 60664 with degree of pollution 3 | | |
| rated value | | |
| Installation altitude at height above sea level | m | 2 000 |
| maximum | | |
| Ambient temperature | | |
| during storage | °C | -40 +80 |
| during operation | °C | -25 +60 |
| Electromagnetic compatibility | | IEC 60947-1 / IEC 61000-6-2 / IEC 61000-6-4 |
| EMI immunity acc. to IEC 60947-1 | | ambience A (industrial sector) |
| EMC emitted interference acc. to IEC 60947-1 | | ambience A (industrial sector) |
| | | |

| Shock resistance | | 15g / 11 ms |
|---|-----|--------------------|
| Vibration resistance | | 10 55 Hz / 0.35 mm |
| Surge voltage resistance rated value | kV | 6 |
| Operating apparent output rated value | V·A | 4 |
| Operating power rated value | W | 2.5 |
| Equipment marking acc. to DIN 40719 extended according to IEC 204-2 acc. to IEC 750 | - | К |
| Equipment marking acc. to DIN EN 61346-2 | | К |
| Mechanical service life (switching cycles) typical | | 10 000 000 |
| Electrical endurance (switching cycles) at AC-15 at 230 V typical | _ | 100 000 |
| Adjustable response delay time | - | |
| • when starting | s | 0 60 |
| with lower or upper limit violation | s | 0 30 |
| Stand-by time for restart after fault | S | 0.3 |
| Phase number | | 3 |
| Number of monitored phases | _ | 2 |
| Product function | | |
| Overcurrent monitoring | | Yes |
| Undercurrent monitoring | | Yes |
| Overcurrent and undercurrent monitoring | | Yes |
| Apparent current monitoring | | Yes |
| active current monitoring | | No |
| undercurrent detection DC | | No |
| undercurrent detection 1 phase | | No |
| Overcurrent detection DC | | No |
| Current window recognition DC | | No |
| undercurrent detection 3 phases | | No |
| Overcurrent detection 1 phase | | No |
| Voltage window recognition 3 phase | | No |
| Voltage window recognition 1 phase | | No |
| phase sequence recognition | | No |
| can be activated or deactivated phase sequence recognition | | No |
| Auto-reset | | Yes |
| • External reset | | No |
| Manual RESET | | Yes |
| Adjustable pick-up value current | | |
| • 1 | А | 1.6 16 |
| • 2 | А | 1.6 16 |
| Relative metering precision | | |
| relating to measuring range limit | % | 10 |
| Type of current for monitoring | | AC |

| Measurable current at AC | А | 1.6 16 |
|---|------|--------|
| Relative switching hysteresis for measured current value | % | 6.25 |
| Response time maximum | ms | 300 |
| Relative repeat accuracy | % | 2 |
| Temperature drift per °C | %/°C | 0.1 |
| Ampacity | | |
| for permanent overcurrent maximum permissible | A | 16 |
| for overcurrent duration < 1 s maximum permissible | A | 320 |

| Type of voltage of the supply voltage | | AC/DC |
|--|----|-------|
| Supply voltage frequency 1 | Hz | 50 60 |
| Supply voltage 1 | | |
| • at DC rated value | V | 24 |
| • at AC | | |
| — at 50 Hz rated value | V | 24 |
| — at 60 Hz rated value | V | 24 |
| Buffering time in the event of power failure minimum | ms | 10 |

| Auxiliary circuit: | | | | |
|--|----|------------------------|--|--|
| Circuit principle of the output relay | | closed-circuit current | | |
| Operating current at 17 V minimum | mA | 5 | | |
| Number of CO contacts | | | | |
| for auxiliary contacts | | 1 | | |
| Operating current of auxiliary contacts | | | | |
| • at AC-15 | | | | |
| — at 24 V | А | 3 | | |
| — at 230 V | А | 3 | | |
| — at 400 V | А | 3 | | |
| • at DC-13 | | | | |
| — at 24 V | А | 1 | | |
| — at 125 V | А | 0.2 | | |
| — at 250 V | А | 0.1 | | |
| | | | | |


Inputs/ Outputs:


Short-circuit:

| Installation/ mounting/ dimensions: | | | | |
|-------------------------------------|----|-----------------|--|--|
| Mounting position | | any | | |
| Mounting type | | direct mounting | | |
| Width | mm | 45 | | |
| Height | mm | 79 | | |


| Depth | mm | 80 |
|--|----|---|
| Required spacing with side-by-side mounting | | |
| • forwards | mm | 0 |
| Backwards | mm | 0 |
| • upwards | mm | 0 |
| • downwards | mm | 0 |
| • at the side | mm | 0 |
| Required spacing for grounded parts | | |
| • forwards | mm | 0 |
| Backwards | mm | 0 |
| • upwards | mm | 0 |
| • downwards | mm | 0 |
| • at the side | mm | 6 |
| Required spacing for live parts | | |
| • forwards | mm | 0 |
| Backwards | mm | 0 |
| • upwards | mm | 0 |
| • downwards | mm | 0 |
| ● at the side | mm | 6 |
| Connections/ Terminals: | | |
| Type of electrical connection | | |
| for main current circuit | | screw-type terminals |
| for auxiliary and control current circuit | | screw-type terminals |
| Product function | | |
| removable terminal for main circuit | | No |
| removable terminal for auxiliary and control circuit | | Yes |
| Type of connectable conductor cross-sections | _ | |
| for main contacts | | |
| — solid | | 2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²), 2x (1 4 mm²) |
| — finely stranded | | |
| — with core end processing | | 2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²) |
| at AWG conductors | | |
| — for main contacts | | 1x 12, 2x (20 14) |
| — for auxiliary contacts | | 2x (20 14) |
| for auxiliary contacts | | |
| — solid | | 1x (0.5 4 mm²), 2x (0.5 2.5 mm²) |
| — finely stranded | | |
| — with core end processing | | 1x (0.5 2.5 mm²), 2x (0.5 1.5 mm²) |
| | | |

| Certificates/ approvals: | | | | | | |
|--|---|--------------------------------|---------------------|----------------------------|------------------------------|--|
| Certificate of suitability | ertificate of suitability CE / UL / CSA | | | | | |
| General Product App | roval | | | EMC | Declaration of Conformity | |
| | SA CSA | | EHC | C-Tick | EG-Konf. | |
| Test Certificates | | Shipping App | roval | | | |
| Special Test Certificate Ce | <u>Type Test</u> ertificates/Test <u>Report</u> | ABS | BUREAU VERITAS | Lloyd's Register Irs | PRS | |
| Shipping Approval | | other | | | | |
| RINA F | MRS . | Environmental Confirmations | <u>Confirmation</u> | | | |
| UL/CSA ratings: | | | | | | |
| Contact rating of auxiliary | contacts acco | rding to UL | B300 / R3 | 300 | | |
| Safety related data: | | | | | | |
| Protection against electrical shock finger-safe | | | | | | |
| Further information | | | | | | |
| Information- and Downloadcenter (Catalogs, Brochures,) http://www.siemens.com/industrial-controls/catalogs | | | | | | |
| Industry Mall (Online ordering system) http://www.siemens.com/industrymall | | | | | | |
| Cax online generator http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RR2141-1AA30 | | | | | | |
| Service&Support (Manuals, Certificates, Characteristics, FAQs,) https://support.industry.siemens.com/cs/ww/en/ps/3RR2141-1AA30 | | | | | | |
| Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros,) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RR2141-1AA30⟨=en | | | | | | |

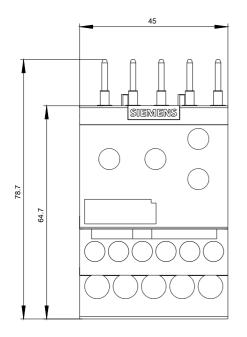

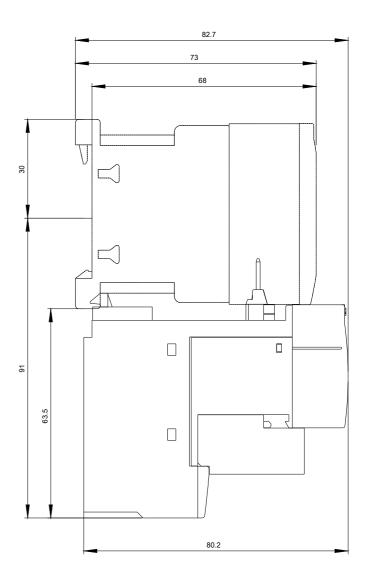

ABBARBA

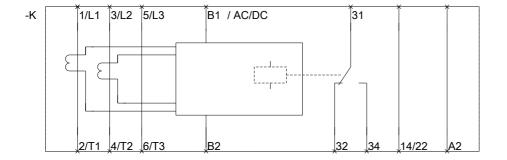

MOINCOR

last modified:

05/31/2017