SIEMENS

Data sheet

3RT1066-6PP35



CONTACTOR, 160KW/400V/AC-3 AC(50...60HZ)/DC OPERATION UC 200-277V AUXILIARY CONTACTS 1NO+1NC 3-POLE, SIZE S10 BAR CONNECTIONS ELECTRONIC OPERATING MECHANISM WITH PLC/SIMOCODE INTERFACE AND REMAIN. LIFETIME INDICATOR

Figure similar

| IRIUS 'ower contactor RT1 |
|---------------------------------|
| |
| RT1 |
| |
| |
| :10 |
| |
| lo |
| /es |
| |
| 000 V |
| |
| kV |
| |
| 90 V |
| |
| |
| 200 |
| l (|

| • of the terminal | IP00 |
|--|----------------------------|
| Shock resistance at rectangular impulse | |
| • at AC | 8,5g / 5 ms, 4,2g / 10 ms |
| • at DC | 8,5g / 5 ms, 4,2g / 10 ms |
| Shock resistance with sine pulse | |
| • at AC | 13,4g / 5 ms, 6,5g / 10 ms |
| • at DC | 13,4g / 5 ms, 6,5g / 10 ms |
| Mechanical service life (switching cycles) | |
| of contactor typical | 10 000 000 |
| of the contactor with added electronics- | 5 000 000 |
| compatible auxiliary switch block typical | |
| of the contactor with added auxiliary switch | 10 000 000 |
| block typical | |
| Ambient conditions | |
| Ambient temperature | |
| during operation | -25 +60 °C |
| • during storage | -55 +80 °C |
| Main circuit | |
| Number of poles for main current circuit | 3 |
| Number of NO contacts for main contacts | 3 |
| Operating voltage | |
| • at AC-3 rated value maximum | 1 000 V |
| Operating current | |
| • at AC-1 at 400 V | |
| — at ambient temperature 40 °C rated value | 330 A |
| ● at AC-1 | |
| — up to 690 V at ambient temperature 40 °C rated value | 330 A |
| — up to 690 V at ambient temperature 60 °C rated value | 300 A |
| — up to 1000 V at ambient temperature 40 °C rated value | 150 A |
| — up to 1000 V at ambient temperature 60 °C rated value | 150 A |
| • at AC-2 at 400 V rated value | 300 A |
| ● at AC-3 | |
| — at 400 V rated value | 300 A |
| — at 500 V rated value | 300 A |
| — at 690 V rated value | 280 A |
| — at 1000 V rated value | 95 A |
| Connectable conductor cross-section in main circuit at AC-1 | |

| • at 60 °C minimum permissible | 185 mm² |
|--|---------------------|
| • at 40 °C minimum permissible | 185 mm ² |
| Operating current for approx. 200000 operating | |
| cycles at AC-4 | |
| • at 400 V rated value | 125 A |
| • at 690 V rated value | 115 A |
| Operating current | |
| at 1 current path at DC-1 | |
| — at 24 V rated value | 300 A |
| — at 110 V rated value | 33 A |
| — at 220 V rated value | 3.8 A |
| — at 440 V rated value | 0.9 A |
| — at 600 V rated value | 0.6 A |
| with 2 current paths in series at DC-1 | |
| — at 24 V rated value | 300 A |
| — at 110 V rated value | 300 A |
| — at 220 V rated value | 300 A |
| — at 440 V rated value | 4 A |
| — at 600 V rated value | 2 A |
| with 3 current paths in series at DC-1 | |
| — at 24 V rated value | 300 A |
| — at 110 V rated value | 300 A |
| — at 220 V rated value | 300 A |
| — at 440 V rated value | 11 A |
| — at 600 V rated value | 5.2 A |
| Operating current | |
| • at 1 current path at DC-3 at DC-5 | |
| — at 24 V rated value | 300 A |
| — at 110 V rated value | 3 A |
| — at 220 V rated value | 0.6 A |
| — at 440 V rated value | 0.18 A |
| — at 600 V rated value | 0.125 A |
| with 2 current paths in series at DC-3 at DC-5 | |
| — at 24 V rated value | 300 A |
| — at 110 V rated value | 300 A |
| — at 220 V rated value | 2.5 A |
| — at 440 V rated value | 0.65 A |
| — at 600 V rated value | 0.37 A |
| with 3 current paths in series at DC-3 at DC-5 | |
| — at 24 V rated value | 300 A |
| — at 110 V rated value | 300 A |
| | |

| — at 220 V rated value | 300 A |
|---|------------------------|
| — at 440 V rated value | 1.4 A |
| — at 600 V rated value | 0.75 A |
| Operating power | |
| ● at AC-1 | |
| — at 230 V at 60 °C rated value | 113 kW |
| — at 400 V rated value | 197 kW |
| — at 400 V at 60 °C rated value | 197 kW |
| — at 690 V rated value | 340 kW |
| — at 690 V at 60 °C rated value | 340 kW |
| — at 1000 V at 60 °C rated value | 246 kW |
| • at AC-2 at 400 V rated value | 160 kW |
| • at AC-3 | |
| — at 230 V rated value | 97 kW |
| — at 400 V rated value | 160 kW |
| — at 500 V rated value | 200 kW |
| — at 690 V rated value | 250 kW |
| — at 1000 V rated value | 132 kW |
| Operating power for approx. 200000 operating cycles | |
| at AC-4 | |
| • at 400 V rated value | 71 kW |
| • at 690 V rated value | 112 kW |
| Thermal short-time current limited to 10 s | 2 400 A |
| Power loss [W] at AC-3 at 400 V for rated value of | 22 W |
| the operating current per conductor | |
| No-load switching frequency | 2 000 1/h |
| • at AC • at DC | 2 000 1/h |
| Operating frequency | |
| • at AC-1 maximum | 750 1/h |
| • at AC-2 maximum | 250 1/h |
| • at AC-3 maximum | 500 1/h |
| • at AC-4 maximum | 130 1/h |
| | |
| Control circuit/ Control | |
| Type of voltage of the control supply voltage | AC/DC |
| Control supply voltage at AC | 200 277 \/ |
| at 50 Hz rated value | 200 277 V 200 277 V |
| at 60 Hz rated value | 200 211 V |
| Control supply voltage at DC | 200 277 V |
| rated value Operating range factor control supply voltage rated | |
| value of magnet coil at AC | |
| | |

| • at 50 Hz | 0.8 1.1 |
|--|--|
| • at 60 Hz | 0.8 1.1 |
| Design of the surge suppressor | with varistor |
| Apparent pick-up power of magnet coil at AC | |
| • at 50 Hz | 530 V·A |
| Inductive power factor with closing power of the coil | |
| • at 50 Hz | 0.8 |
| Apparent holding power of magnet coil at AC | |
| • at 50 Hz | 5 V·A |
| Inductive power factor with the holding power of the | |
| coil | |
| • at 50 Hz | 0.5 |
| Closing power of magnet coil at DC | 580 W |
| Holding power of magnet coil at DC | 3.4 W |
| Closing delay | |
| • at AC | 45 80 ms |
| • at DC | 45 80 ms |
| Opening delay | |
| • at AC | 80 100 ms |
| • at DC | 80 100 ms |
| Arcing time | 10 15 ms |
| | |
| Auxiliary circuit | |
| Auxiliary circuit Number of NC contacts | |
| | |
| Number of NC contacts | 1 |
| Number of NC contactsfor auxiliary contacts | 1 |
| Number of NC contacts for auxiliary contacts instantaneous contact | 1 |
| Number of NC contacts for auxiliary contacts instantaneous contact Number of NO contacts | 1 |
| Number of NC contacts • for auxiliary contacts — instantaneous contact Number of NO contacts • for auxiliary contacts | |
| Number of NC contacts for auxiliary contacts instantaneous contact Number of NO contacts for auxiliary contacts instantaneous contact | 1 |
| Number of NC contacts for auxiliary contacts instantaneous contact Number of NO contacts for auxiliary contacts instantaneous contact Operating current at AC-12 maximum | 1 |
| Number of NC contacts • for auxiliary contacts — instantaneous contact Number of NO contacts • for auxiliary contacts — instantaneous contact Operating current at AC-12 maximum Operating current at AC-15 | 1 10 A |
| Number of NC contacts • for auxiliary contacts — instantaneous contact Number of NO contacts • for auxiliary contacts — instantaneous contact Operating current at AC-12 maximum Operating current at AC-15 • at 230 V rated value | 1 10 A 6 A |
| Number of NC contacts • for auxiliary contacts — instantaneous contact Number of NO contacts • for auxiliary contacts — instantaneous contact Operating current at AC-12 maximum Operating current at AC-15 • at 230 V rated value • at 400 V rated value | 1 10 A 6 A 3 A |
| Number of NC contacts for auxiliary contacts instantaneous contact Number of NO contacts for auxiliary contacts for auxiliary contacts instantaneous contact Operating current at AC-12 maximum Operating current at AC-15 at 230 V rated value at 400 V rated value at 500 V rated value | 1 10 A 6 A 3 A 2 A |
| Number of NC contacts • for auxiliary contacts — instantaneous contact Number of NO contacts • for auxiliary contacts — instantaneous contact Operating current at AC-12 maximum Operating current at AC-15 • at 230 V rated value • at 500 V rated value • at 690 V rated value | 1 10 A 6 A 3 A 2 A |
| Number of NC contacts • for auxiliary contacts — instantaneous contact Number of NO contacts • for auxiliary contacts — instantaneous contact Operating current at AC-12 maximum Operating current at AC-15 • at 230 V rated value • at 500 V rated value • at 690 V rated value • at 690 V rated value | 1 10 A 6 A 3 A 2 A 1 A |
| Number of NC contacts • for auxiliary contacts — instantaneous contact Number of NO contacts • for auxiliary contacts — instantaneous contact Operating current at AC-12 maximum Operating current at AC-15 • at 230 V rated value • at 500 V rated value • at 500 V rated value • at 690 V rated value • at 24 V rated value | 1 10 A 6 A 3 A 2 A 1 A 10 A |
| Number of NC contacts • for auxiliary contacts — instantaneous contact Number of NO contacts • for auxiliary contacts — instantaneous contact Operating current at AC-12 maximum Operating current at AC-15 • at 230 V rated value • at 400 V rated value • at 690 V rated value • at 24 V rated value • at 24 V rated value • at 48 V rated value | 1 10 A 6 A 3 A 2 A 1 A 10 A 6 A |
| Number of NC contacts • for auxiliary contacts — instantaneous contact Number of NO contacts • for auxiliary contacts — instantaneous contact Operating current at AC-12 maximum Operating current at AC-15 • at 230 V rated value • at 500 V rated value • at 500 V rated value • at 690 V rated value • at 48 V rated value • at 48 V rated value • at 60 V rated value | 1 10 A 6 A 3 A 2 A 1 A 10 A 6 A 6 A |
| Number of NC contacts • for auxiliary contacts — instantaneous contact Number of NO contacts • for auxiliary contacts — instantaneous contact Operating current at AC-12 maximum Operating current at AC-15 • at 230 V rated value • at 400 V rated value • at 500 V rated value • at 500 V rated value • at 690 V rated value • at 24 V rated value • at 24 V rated value • at 60 V rated value • at 60 V rated value • at 110 V rated value | 1 10 A 6 A 3 A 2 A 1 A 10 A 6 A 6 A 3 A 3 A |
| Number of NC contacts • for auxiliary contacts — instantaneous contact Number of NO contacts • for auxiliary contacts — instantaneous contact Operating current at AC-12 maximum Operating current at AC-15 • at 230 V rated value • at 500 V rated value • at 690 V rated value • at 690 V rated value • at 44 V rated value • at 48 V rated value • at 48 V rated value • at 110 V rated value • at 125 V rated value | 1 10 A 6 A 3 A 2 A 1 A 10 A 6 A 6 A 6 A 3 A 2 A |

| Operating current at DC-13 | |
|---|---|
| • at 24 V rated value | 10 A |
| • at 48 V rated value | 2 A |
| • at 60 V rated value | 2 A |
| • at 110 V rated value | 1 A |
| • at 125 V rated value | 0.9 A |
| • at 220 V rated value | 0.3 A |
| • at 600 V rated value | 0.1 A |
| Contact reliability of auxiliary contacts | 1 faulty switching per 100 million (17 V, 1 mA) |

UL/CSA ratings

| Full-load current (FLA) for three-phase AC motor | |
|--|-------------|
| • at 480 V rated value | 302 A |
| • at 600 V rated value | 289 A |
| Yielded mechanical performance [hp] | |
| for three-phase AC motor | |
| — at 200/208 V rated value | 100 hp |
| — at 220/230 V rated value | 125 hp |
| — at 460/480 V rated value | 250 hp |
| — at 575/600 V rated value | 300 hp |
| Contact rating of auxiliary contacts according to UL | A600 / Q600 |

Short-circuit protection Design of the fuse link For short-circuit protection of the main circuit - with type of coordination 1 required Fuse gG: 500 A - with type of assignment 2 required Fuse gG: 400 A • for short-circuit protection of the auxiliary switch required fuse gG: 10 A

| Installation/ mounting/ dimensions | |
|---|--|
| Mounting position | +/-180° rotation possible on vertical mounting surface; can be tilted forward and backward by +/- 22.5° on vertical mounting surface |
| Mounting type | screw fixing |
| Side-by-side mounting | Yes |
| Height | 210 mm |
| Width | 165 mm |
| Depth | 202 mm |
| Required spacing | |
| for grounded parts | |
| — at the side | 10 mm |
| Connections/Terminals | |

Type of electrical connection

| • Ior main currer | IL CALCUIT | | ccrow_type terminale | | |
|---|---|--|--|---|----------------------------------|
| for main current circuit for auxiliary and control current circuit | | | screw-type terminals | | |
| • for auxiliary and control current circuit Type of connectable conductor cross-sections | | | screw-type terminals | | |
| | | | 2/0 500 kcmil | | |
| | at AWG conductors for main contacts Type of connectable conductor cross-sections | | | | |
| | | cuons | | | |
| for auxiliary contacts — solid | | | 0 | 0.75 0.5 mm²) maa | ··· 0··· (0.75 |
| | | | 2x (0.5 1.5 mm ²), 2x (0.75 2.5 mm ²), max. 2x (0.75 4 mm ²) | | |
| — single or multi-stranded | | 2x (0,5 1,5 mm ²), 2x (0,75 2,5 mm ²), max. 2x (0,75 4 mm ²) | | | |
| - | finely stranded with core end processing | | 2x (0.5 1.5 mm²), 2x (0.75 2.5 mm²) | | |
| at AWG condu | at AWG conductors for auxiliary contacts | | 2x (20 16), 2x (18 14), 1x 12 | | |
| Safety related data | | | | | |
| Product function | | | | | |
| Mirror contact a | acc. to IEC 60947-4- | -1 | Yes | | |
| positively drive | n operation acc. to I | EC 60947-5- | No | | |
| 1 | | | | | |
| Protection against el | ectrical shock | | finger-safe when touche | d vertically from front | acc. to IEC 60529 |
| Certificates/approva | als | | | | |
| General Product | | | | Functional | Declaration of |
| | • • | | | | |
| | | | | Safety/Safety | Conformity |
| | | | | Safety/Safety of Machinery | Conformity |
| | <u> </u> | <u> </u> | | | Conformity |
| | (SI) | መ | C 0 F | of Machinery | Conformity |
| | (SP) | <u>ل</u> | EAC | of Machinery Type Examination | CE |
| | CSA | | EAC | of Machinery Type Examination | Conformity Cefection EG-Konf. |
| | S CSA | UL | EAC | of Machinery Type Examination | CE |
| CCC Test Certificates | CSA | UL UL Marine / Sh | 6116 | of Machinery Type Examination | CE |
| | Type Test | UL UL Marine / Sh | 6116 | of Machinery Type Examination Certificate | EG-Konf. |
| Test Certificates | Type Test Certificates/Test | | ipping | of Machinery Type Examination Certificate | CE |
| Test Certificates | Type Test | Station of the state | ipping | of Machinery Type Examination Certificate | EG-Konf. |
| Test Certificates | Type Test Certificates/Test | | ipping | of Machinery <u>Type Examination</u> <u>Certificate</u> | EG-Konf. |
| Test Certificates | Type Test Certificates/Test | Station of the state | ipping | of Machinery Type Examination Certificate | EG-Konf. |
| Test Certificates | Type Test Certificates/Test | Station of the state | ipping | of Machinery Type Examination Certificate | EG-Konf. |
| Test Certificates | Type Test Certificates/Test Report | Station of the state | ipping RMRS | of Machinery Type Examination Certificate | EG-Konf. |
| Test Certificates Special Test Certificate other | <u>Type Test</u> <u>Certificates/Test</u> <u>Report</u> | ABS | ipping RMRS | of Machinery Type Examination Certificate | EG-Konf. |

Information- and Downloadcenter (Catalogs, Brochures,...) http://www.siemens.com/industrial-controls/catalogs


Industry Mall (Online ordering system) https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3RT1066-6PP35


Cax online generator

http://support.automation.siemens.com/WW/CAXorder/default.aspx?lang=en&mlfb=3RT1066-6PP35

Service&Support (Manuals, Certificates, Characteristics, FAQs,...) https://support.industry.siemens.com/cs/ww/en/ps/3RT1066-6PP35

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RT1066-6PP35&lang=en

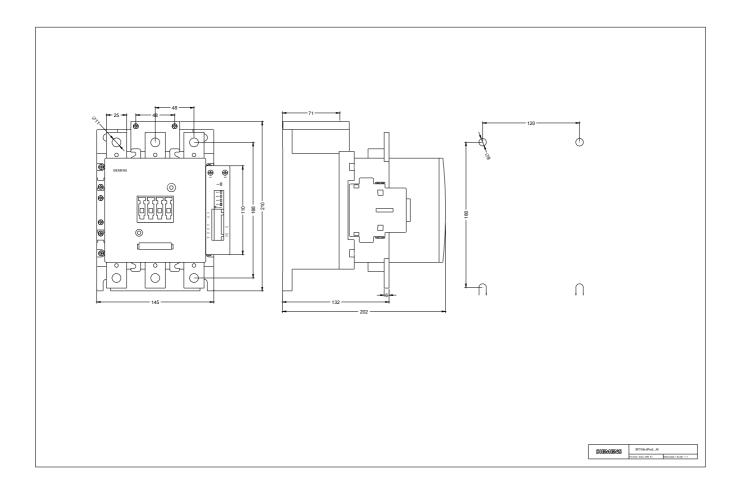

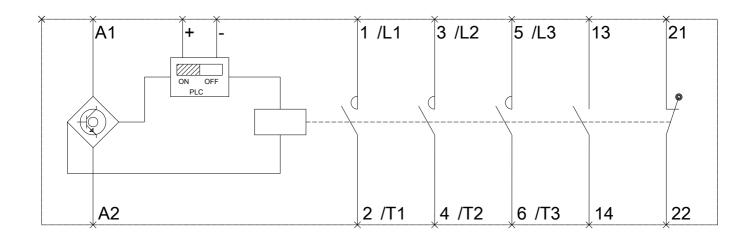

last modified:

07/14/2017