



NZM4 PXR20 circuit breaker, 1000A, 3p, screw terminal

Part no. **NZMN4-VX1000**  
 Catalog No. **191425**

Similar to illustration

### Delivery program

|                     |  |  |  |
|---------------------|--|--|--|
| Product range       |  |  | Circuit-breaker  |
| Protective function |  |  | Systems, cable, selectivity and generator protection   |
| Standard/Approval   |  |  | IEC  |
| Installation type   |  |  | Fixed  |
| Release system      |  |  | Electronic release   |
| Construction size   |  |  | NZM4   |
| Description         |  |  | LSI overload protection and delayed and non-delayed short-circuit protective device<br>R.m.s. value measurement and "thermal memory"<br>USB interface for configuration and test function with Power Xpert Protection Manager software<br>Optionally communication-capable with interface module and internal Modbus RTU module or CAM |
| Number of poles     |  |  | 3 pole   |
| Standard equipment  |  |  | Screw connection   |





### Switching capacity

|                 |          |    |    |
|-----------------|----------|----|----|
| 400/415 V 50 Hz | $I_{cu}$ | kA | 50 |
|-----------------|----------|----|----|

### Rated current = rated uninterrupted current

|   |             |   |      |
|---|-------------|---|------|
| Rated current = rated uninterrupted current | $I_n = I_u$ | A | 1000 |
|---|-------------|---|------|

### Setting range

|   |                             |   |            |
|---|-----------------------------|---|------------|
| Overload trip   |                             |   |            |
|  | $I_r$                       | A | 400 - 1000 |
| Short-circuit releases  |                             |   |            |
|  |                             |   |            |
| Non-delayed   | $I_i = I_n \times \dots$    |   | 2 - 12     |
|  |                             |   |            |
| Delayed   | $I_{sd} = I_r \times \dots$ |   | 2 - 10     |
|  |                             |   |            |

### Technical data

#### General

|   |  |      |  |
|---|--|------|--|
| Standards   |  |      | IEC/EN 60947   |
| Protection against direct contact   |  |      | Finger and back of hand proof to VDE 0106 Part 100                             |
| Climatic proofing   |  |      | Damp heat, constant, to IEC 60068-2-78<br>Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature   |  |      |  |
| Ambient temperature, storage  |  | °C   | - 40 - + 70  |
| Operation   |  | °C   | -25 - +70  |
| Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 |  | g    | 15 (half-sinusoidal shock 11 ms)   |
| Safe isolation to EN 61140  |  |      |  |
| Between auxiliary contacts and main contacts  |  | V AC | 500  |

|  |      |  |   |
|--|------|--|---|
| between the auxiliary contacts         | V AC | 300  |   |
| Mounting position                      |      | Vertical and 90° in all directions                                       |  <p>With XFI earth-fault release:<br/> - NZM1, N1, NZM2, N2: vertical and 90° in all directions<br/> with plug-in unit<br/> - NZM1, N1, NZM2, N2: vertical, 90° right/left<br/> with withdrawable unit:<br/> - NZM3, N3: vertical, 90° right/left<br/> - NZM4, N4: vertical<br/> with remote operator:<br/> - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions</p> |
| Direction of incoming supply           |      | as required  |   |
| Degree of protection                   |      |  |   |
| Device                                 |      | In the operating controls area: IP20 (basic degree of protection)        |   |
| Enclosures                             |      | With insulating surround: IP40<br>With door coupling rotary handle: IP66 |   |
| Terminations                           |      | Tunnel terminal: IP10<br>Phase isolator and strip terminal: IP00         |   |
| Other technical data (sheet catalogue) |      | Weight<br>Temperature dependency, Derating<br>Effective power loss       |   |

### Circuit-breakers

|   |             |      |            |
|---|-------------|------|------------|
| Rated current = rated uninterrupted current | $I_n = I_u$ | A    | 1000       |
| Rated surge voltage invariability           | $U_{imp}$   |      |            |
| Main contacts                               |             | V    | 8000       |
| Auxiliary contacts                          |             | V    | 6000       |
| Rated operational voltage                   | $U_e$       | V AC | 690        |
| Overvoltage category/pollution degree       |             |      | III/3      |
| Rated insulation voltage                    | $U_i$       | V    | 690        |
| Use in unearthed supply systems             |             | V    | $\leq 525$ |

### Switching capacity

|   |            |    |   |
|---|------------|----|---|
| Rated short-circuit making capacity   | $I_{cm}$   |    |   |
| 240 V   | $I_{cm}$   | kA | 110   |
| 400/415 V   | $I_{cm}$   | kA | 110   |
| 440 V 50/60 Hz  | $I_{cm}$   | kA | 77  |
| 525 V 50/60 Hz  | $I_{cm}$   | kA | 55  |
| 690 V 50/60 H   | $I_c$      | kA | 40  |
| Rated short-circuit breaking capacity $I_{cn}$                              | $I_{cn}$   |    |   |
| $I_{cu}$ to IEC/EN 60947 test cycle O-t-CO                                  | $I_{cu}$   | kA |   |
| 240 V 50/60 Hz  | $I_{cu}$   | kA | 50  |
| 400/415 V 50/60 Hz  | $I_{cu}$   | kA | 50  |
| 440 V 50/60 Hz  | $I_{cu}$   | kA | 35  |
| 525 V 50/60 Hz  | $I_{cu}$   | kA | 25  |
| 690 V 50/60 Hz  | $I_{cu}$   | kA | 20  |
| $I_{cs}$ to IEC/EN 60947 test cycle O-t-CO-t-CO                             | $I_{cs}$   | kA |   |
| 240 V 50/60 Hz  | $I_{cs}$   | kA | 37  |
| 400/415 V 50/60 Hz  | $I_{cs}$   | kA | 37  |
| 440 V 50/60 Hz  | $I_{cs}$   | kA | 26  |
| 525 V 50/60 Hz  | $I_{cs}$   | kA | 19  |
| 690 V 50/60 Hz  | $I_{cs}$   | kA | 15  |
|   |            |    | Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker. |
| Rated short-time withstand current  |            |    |   |
| $t = 0.3$ s   | $I_{cw}$   | kA | 12  |
| $t = 1$ s   | $I_{cw}$   | kA | 12  |
| Utilization category to IEC/EN 60947-2                                      |            |    | B   |
| Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release) | Operations |    | 10000   |

|                                   |            |       |                            |
|-----------------------------------|------------|-------|----------------------------|
| Lifespan, electrical              |            |       |                            |
| AC-1                              |            |       |                            |
| 400 V 50/60 Hz                    | Operations |       | 3000                       |
| 415 V 50/60 Hz                    | Operations |       | 3000                       |
| 690 V 50/60 Hz                    | Operations |       | 20000                      |
| Max. operating frequency          |            | Ops/h | 60                         |
| Total break time at short-circuit |            | ms    | < 25 ≤ 415 V; < 35 > 415 V |

### Terminal capacity

|   |      |                 |  |  |
|---|------|-----------------|--|--|
| Standard equipment  |      |                 |  | Screw connection                                     |
| Optional accessories                                      |      |                 |  | Tunnel terminal connection on rear<br>Strip terminal |
| Round copper conductor                                    |      |                 |  |  |
| Tunnel terminal   |      |                 |  |  |
| Stranded  |      |                 |  |  |
| 4-hole  |      | mm <sup>2</sup> |  | 4 x (50 - 240)                                       |
| Bolt terminal and rear-side connection                    |      |                 |  |  |
| Direct on the switch                                      |      |                 |  |  |
| Stranded  |      |                 |  |  |
|   |      | mm <sup>2</sup> |  | 1 x (120 - 185)<br>4 x (50 - 185)                    |
| Module plate  |      |                 |  |  |
| Single hole   | min. | mm <sup>2</sup> |  | 1 x (120 - 300)                                      |
| Single hole   | max. | mm <sup>2</sup> |  | 2 x (95 - 300)                                       |
| Module plate  |      |                 |  |  |
| Double hole   | min. | mm <sup>2</sup> |  | 2 x (95 - 185)                                       |
| Double hole   | max. | mm <sup>2</sup> |  | 4 x (35 - 185)                                       |
| Connection width extension                                |      |                 |  |  |
| Connection width extension                                |      | mm <sup>2</sup> |  | 4 x 300<br>6 x (95 - 240)                            |
| Al circular conductor                                     |      |                 |  |  |
| Tunnel terminal   |      |                 |  |  |
| Stranded  |      |                 |  |  |
| 4-hole  |      | mm <sup>2</sup> |  | 4 x (50 - 240)                                       |
| Cu strip (number of segments x width x segment thickness) |      |                 |  |  |
| Flat conductor terminal                                   |      |                 |  |  |
|   | min. | mm              |  | 6 x 16 x 0.8   |
|   | max. | mm              |  | (2 x) 10 x 32 x 1.0                                  |
| Module plate  |      |                 |  |  |
| Single hole   |      | mm              |  | (2 x) 10 x 50 x 1.0                                  |
| Bolt terminal and rear-side connection                    |      |                 |  |  |
| Flat copper strip, with holes                             | min. | mm              |  | 5 x 25 x 1.0   |
| Flat copper strip, with holes                             | max. | mm              |  | (2 x) 10 x 50 x 1.0                                  |
| Connection width extension                                |      | mm              |  | (2 x) 10 x 80 x 1.0                                  |
| Copper busbar (width x thickness)                         |      |                 |  |  |
| Bolt terminal and rear-side connection                    |      |                 |  |  |
| Screw connection  |      |                 |  |  |
| Direct on the switch                                      |      |                 |  |  |
|   | min. | mm              |  | 25 x 5   |
|   | max. | mm              |  | 2 x (50 x 10)  |
| Module plate  |      |                 |  |  |
| Single hole   | min. | mm              |  | 25 x 5   |
| Single hole   | max. | mm              |  | 2 x (50 x 10)  |
| Module plate  |      |                 |  |  |
| Double hole   |      | mm              |  | 2 x (50 x 10)  |
| Connection width extension                                |      |                 |  |  |
| Connection width extension                                | min. | mm              |  | 60 x 10  |

|                            |      |                 |                                      |
|----------------------------|------|-----------------|--------------------------------------|
| Connection width extension | max. | mm              | 2 x (80 x 10)                        |
| Control cables             |      |                 |                                      |
|                            |      | mm <sup>2</sup> | 1 x (0.75 - 2.5)<br>2 x (0.75 - 1.5) |

## Design verification as per IEC/EN 61439


| Technical data for design verification   |                  |    |  |
|--|------------------|----|--|
| Rated operational current for specified heat dissipation   | I <sub>n</sub>   | A  | 1000   |
| Equipment heat dissipation, current-dependent  | P <sub>vid</sub> | W  | 165  |
| Operating ambient temperature min.   |                  | °C | -25  |
| Operating ambient temperature max.   |                  | °C | 70   |
| IEC/EN 61439 design verification   |                  |    |  |
| 10.2 Strength of materials and parts   |                  |    |  |
| 10.2.2 Corrosion resistance  |                  |    | Meets the product standard's requirements.   |
| 10.2.3.1 Verification of thermal stability of enclosures   |                  |    | Meets the product standard's requirements.   |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat   |                  |    | Meets the product standard's requirements.   |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects |                  |    | Meets the product standard's requirements.   |
| 10.2.4 Resistance to ultra-violet (UV) radiation   |                  |    | Meets the product standard's requirements.   |
| 10.2.5 Lifting   |                  |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.2.6 Mechanical impact   |                  |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.2.7 Inscriptions  |                  |    | Meets the product standard's requirements.   |
| 10.3 Degree of protection of ASSEMBLIES  |                  |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.4 Clearances and creepage distances   |                  |    | Meets the product standard's requirements.   |
| 10.5 Protection against electric shock   |                  |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.6 Incorporation of switching devices and components   |                  |    | Does not apply, since the entire switchgear needs to be evaluated.   |
| 10.7 Internal electrical circuits and connections  |                  |    | Is the panel builder's responsibility.   |
| 10.8 Connections for external conductors   |                  |    | Is the panel builder's responsibility.   |
| 10.9 Insulation properties   |                  |    |  |
| 10.9.2 Power-frequency electric strength   |                  |    | Is the panel builder's responsibility.   |
| 10.9.3 Impulse withstand voltage   |                  |    | Is the panel builder's responsibility.   |
| 10.9.4 Testing of enclosures made of insulating material   |                  |    | Is the panel builder's responsibility.   |
| 10.10 Temperature rise   |                  |    | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating   |                  |    | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.12 Electromagnetic compatibility  |                  |    | Is the panel builder's responsibility. The specifications for the switchgear must be observed.                                   |
| 10.13 Mechanical function  |                  |    | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.                         |

## Technical data ETIM 8.0

| Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)  |  |    |  |
|--|--|----|--|
| Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ec@ss10.0.1-27-37-04-09 [AJZ716013]) |  |    |  |
| Rated permanent current I <sub>u</sub>   |  | A  | 1000                                     |
| Rated voltage  |  | V  | 690 - 690                                |
| Rated short-circuit breaking capacity I <sub>cu</sub> at 400 V, 50 Hz  |  | kA | 37                                       |
| Overload release current setting   |  | A  | 400 - 1000                               |
| Adjustment range short-term delayed short-circuit release  |  | A  | 2 - 10                                   |
| Adjustment range undelayed short-circuit release   |  | A  | 2 - 18                                   |
| Integrated earth fault protection  |  |    | No                                       |
| Type of electrical connection of main circuit  |  |    | Screw connection                         |
| Device construction  |  |    | Built-in device fixed built-in technique |
| Suitable for DIN rail (top hat rail) mounting  |  |    | No                                       |
| DIN rail (top hat rail) mounting optional  |  |    | No                                       |
| Number of auxiliary contacts as normally closed contact  |  |    | 0  |
| Number of auxiliary contacts as normally open contact  |  |    | 0  |

|   |  |              |
|---|--|--------------|
| Number of auxiliary contacts as change-over contact |  | 0            |
| With switched-off indicator                         |  | No           |
| With integrated under voltage release               |  | No           |
| Number of poles                                     |  | 3            |
| Position of connection for main current circuit     |  | Front side   |
| Type of control element                             |  | Rocker lever |
| Complete device with protection unit                |  | Yes          |
| Motor drive integrated                              |  | No           |
| Motor drive optional                                |  | Yes          |
| Degree of protection (IP)                           |  | IP20         |

## Dimensions

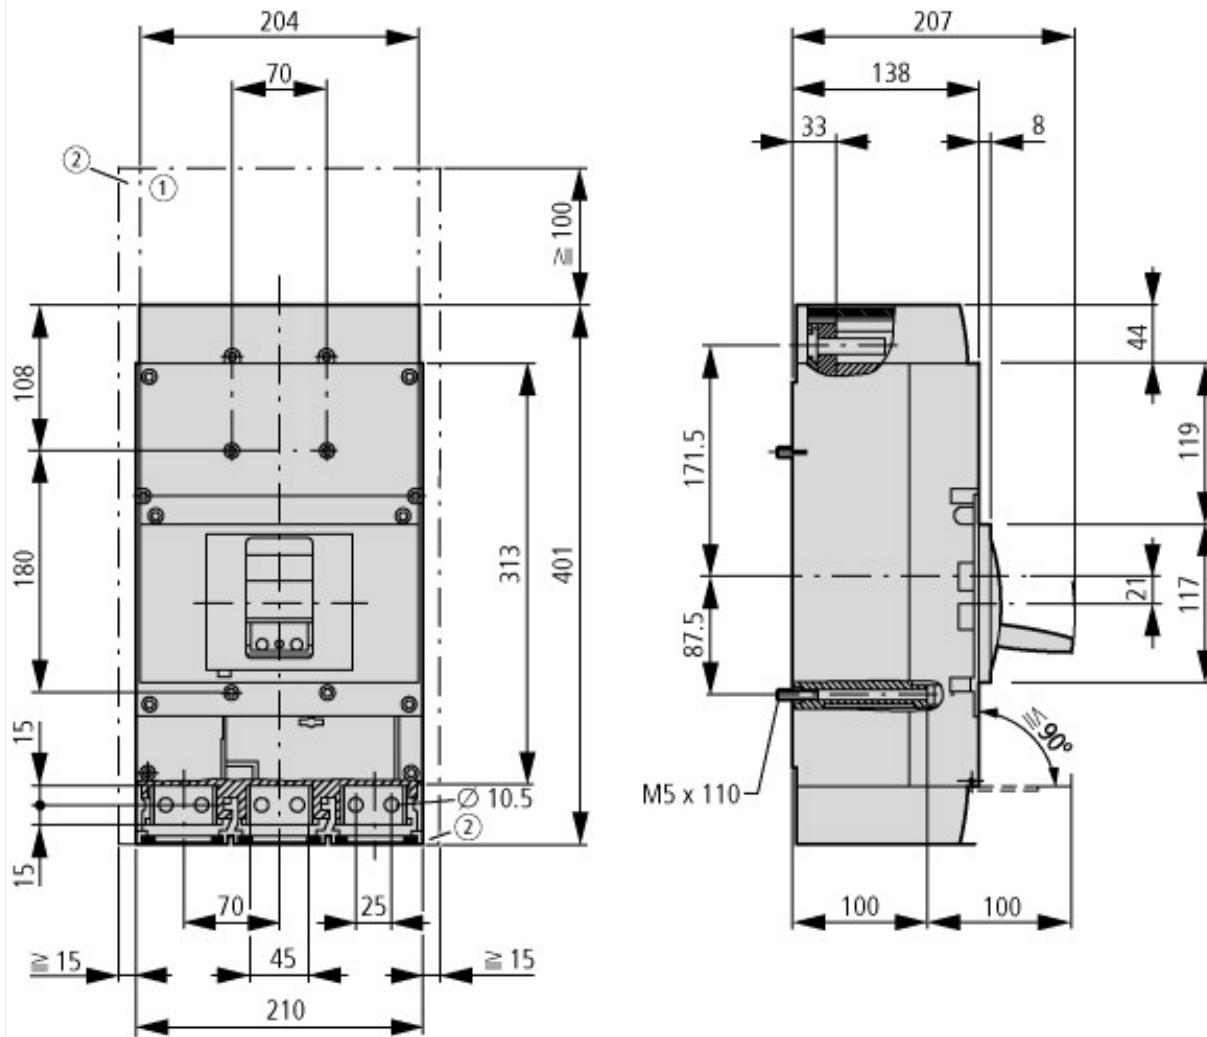

- ① Blow out area, minimum clearance to adjacent parts  
 $U_i \leq 690$  V: 100 mm  
 $U_i \leq 1500$  V: 200 mm
- ② Minimum clearance to adjacent parts  
 $U_i \leq 1000$  V: 15 mm  
 $U_i \leq 1500$  V: 70 mm

## Additional product information (links)

### IL012101ZU NZM4-PXR circuit-breaker, basic device, NZM4-PXR Circuit-Breaker, basic unit

|   |   |
|---|---|
| IL012101ZU NZM4-PXR circuit-breaker, basic device, NZM4-PXR Circuit-Breaker, basic unit | <a href="https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL012101ZU2022_01.pdf">https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL012101ZU2022_01.pdf</a> |
| Weight  | <a href="http://ecat.moeller.net/flip-cat/?edition=HPLEN&amp;startpage=17.171">http://ecat.moeller.net/flip-cat/?edition=HPLEN&amp;startpage=17.171</a>                         |
| Temperature dependency, Derating  | <a href="http://ecat.moeller.net/flip-cat/?edition=HPLEN&amp;startpage=17.172">http://ecat.moeller.net/flip-cat/?edition=HPLEN&amp;startpage=17.172</a>                         |
| Effective power loss  | <a href="http://ecat.moeller.net/flip-cat/?edition=HPLEN&amp;startpage=17.174">http://ecat.moeller.net/flip-cat/?edition=HPLEN&amp;startpage=17.174</a>                         |
| additional technical information for NZM power switch                                   | <a href="https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technik_de_en.pdf">https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technik_de_en.pdf</a>                           |